

DECLARATION OF CONFORMITY TO THE ITALIAN GRID CODE STANDARD

Italy grid codes Standards require an operation outside of the IEC 60034 Voltage and Frequency range. The alternators are designed to be in compliance with

- Italian CEI 0-16 ed. 2022-03
- Italian CEI 0-21 ed. 2022-03, chapter 8. 4. 1. 2 & chapter 8. 4. 4

MOTEURS LEROY-SOMER
Boulevard Marcellin Leroy
CS 10015
16915 ANGOULEME Cedex 9
France

MLS HOLICE SPOL.SRO
Sladkovskeho 43
772 04 OLOMOUC
Czech Republic

MOTEURS LEROY-SOMER
1, rue de la Burelle
Boite Postale 1517
45800 St Jean de Braye
France

Hereby declares that for its range of synchronous alternators


- Low Voltage: LSA 40 - 42.3 - 43.2 - 44.2 - 44.3 - 46.2 - 46.3- 47.2 - 47.3 - 49.1 - 49.3 - 50.2 - 51.2 - 52.2 - 52.3 - 53 - 53.2 - 54 - 54.2 - 56 - 58
- Medium Voltage (up to 11 kV): LSA 50 - 52.2 - 53 - 53.2 - 54 - 54.2 - 55 - 56 - 58 - 60 - 62
- As well as any derivated product

The temperature rise of the stator and rotor windings, at a given shaft power at nominal Voltage / frequency, power factor 0.8 lagging, 40°C cold air temperature and at altitudes not higher than 1,000m must not exceed temperature rise according class F according IEC 60034.

Generators are compliant for operations within the frequency range 47,5 Hz to 51,5 Hz and within the voltage range 85% to 110% of nominal voltage, as required by above mentioned rules.

A power reduction must take place below 49 Hz and above 51 Hz according the following graph.

Power reduction during operation with under frequency

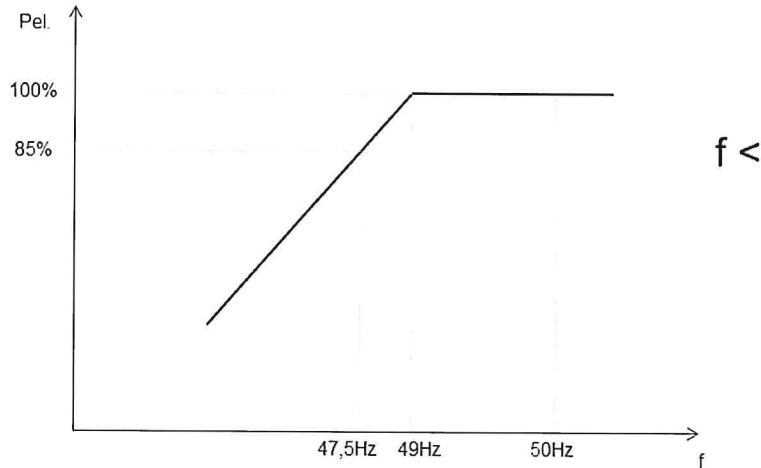

Under worst operation cases for voltage, frequency & power factor ranges the temperature rise may be higher than class F but will be managed in order to not exceed temperature rise of thermal class H according to IEC 60034.

Le 12/09/22

Patrice Betge
Engineering Director,
Electric Power Generation

Nidec
MOTEURS LEROY-SOMER
SAS au capital de 38 679 664 euros
Siège Social
Boulevard Marcellin Leroy - CS 10015
16915 Angoulême Cedex 9 - France
Tél. +33 (0)5 45 64 45 64
338 567 258 RCS Angoulême N°6